

A comparison of the rise of the temperature of an unprotected steel column subjected to the standard fire curve ISO 834 and to a natural fire model in the office¹

Maciej SZUMIGAŁA, Łukasz POLUS

Institute of Structural Engineering, Faculty of Civil and Environmental Engineering, Poznan University of Technology, Piotrowo 5, 60-965 Poznan, Poland; lukasz.polus@put.poznan.pl

Abstract: The paper presents a comparison of the changes in the temperature of a steel HEB 300-section column in a standard fire curve and in a natural fire. The EN 1991-1-2 standard and the Fire Dynamics Simulator were used to calculate the temperature of the steel column in a fire situation. The temperature of the steel column based on Eurocodes using the ISO 834 curve was different from the temperature obtained from the Fire Dynamics Simulator, modeling a natural fire.

Key words: fire safety, Fire Dynamics Simulator, natural fire model, standard fire curve

1. INTRODUCTION

Fire safety is very important. All the structural elements of a building should have a fire resistance degree ensuring a safe evacuation of people. Fire resistance requirements for buildings are regulated by the national law. Thermal action can be analyzed using different methods [1]. They include the temperature-time curve and the natural fire model [2]. The first method presents the evolution of the temperature of the gases surrounding the element as a function of time. This temperature determines the heat flux transmitted from the hot gases to the steel element [2]. The second method focuses on the heat flux affecting the element. The temperature of the steel element is determined using the combination of the heat flux affecting the element and the flux reemitted by the element [2]. The ISO 834 curve is used to determine the fire resistance of construction elements. Natural fire models are rarely used in the design process, because they need special software and are more time-consuming. The existing regulations provide for the use of the standard ISO curve to verify the fire resistance of structural elements. The question is whether it is possible to use a natural fire model to verify the fire resistance of structural elements. In Poland, the commander of the provincial fire brigade may grant an authorization to use natural fire models to verify the durability of the elements of a particular building in fire.

There are a lot of papers on natural fire models. Some of them are about designing buildings in fire conditions using natural fire models [21]. RZESZUT and POLUS [3] observed that the results obtained based on time-temperature relationships may be significantly different from the ones based on a natural fire model. The authors [3] analyzed a steel beam in a fire situation. The temperature of the beam in a natural fire of a city bus was lower than the temperature obtained in the procedure according to the standard time-temperature ISO curve [3]. The Fire Dynamics Simulator is a program which can be used to simulate a fire. It is a computational fluid dynamic (CFD) model of a fire-driven fluid flow [4]. The results of an FDS simulation may be displayed in a separate visualization program called Smokeview [5]. Models of buildings may be prepared in the PyroSim program, which

¹ A paper presented at the 1st National Student's Conference BUDMIKA 2014, Poznan, April 23-25, 2014.

is a graphic user interface for the Fire Dynamics Simulator [6]. In many cases, a design using the ISO 834 temperature-time curve results in an increased spending on fire protection measures [7]. A design based on a natural fire takes into account the size of the fire zone, the construction of the room, the number of vents, the furnishing, the amount of combustible material, the size of the fire load, the speed of heat and the ventilation rate. A report should contain the following details of the model: name and version of the program, details of sub-models, input data, assumptions, number of cells, evidence that convergence was achieved throughout the simulation, evidence that the result is insensitive to the number of cells, demonstration of sensitivity to other variable parameters, e.g. an open window vs. a closed window [8][9]. The full-scale experiments conducted by the State Key Laboratory of Fire Science in China show the difference between the rise of the temperature of a space truss according to the ISO 834 curve and a large-space building fire [20]. In 2002, the National Institute of Standards and Technology recommended the improvement of “*the century-old standard for the testing of building components, assemblies and systems*” [12]. Natural fire curves can be used instead of the ISO 834 curve. The ISO curve and natural fire curves are not identical, which is presented in Figure 1.1.

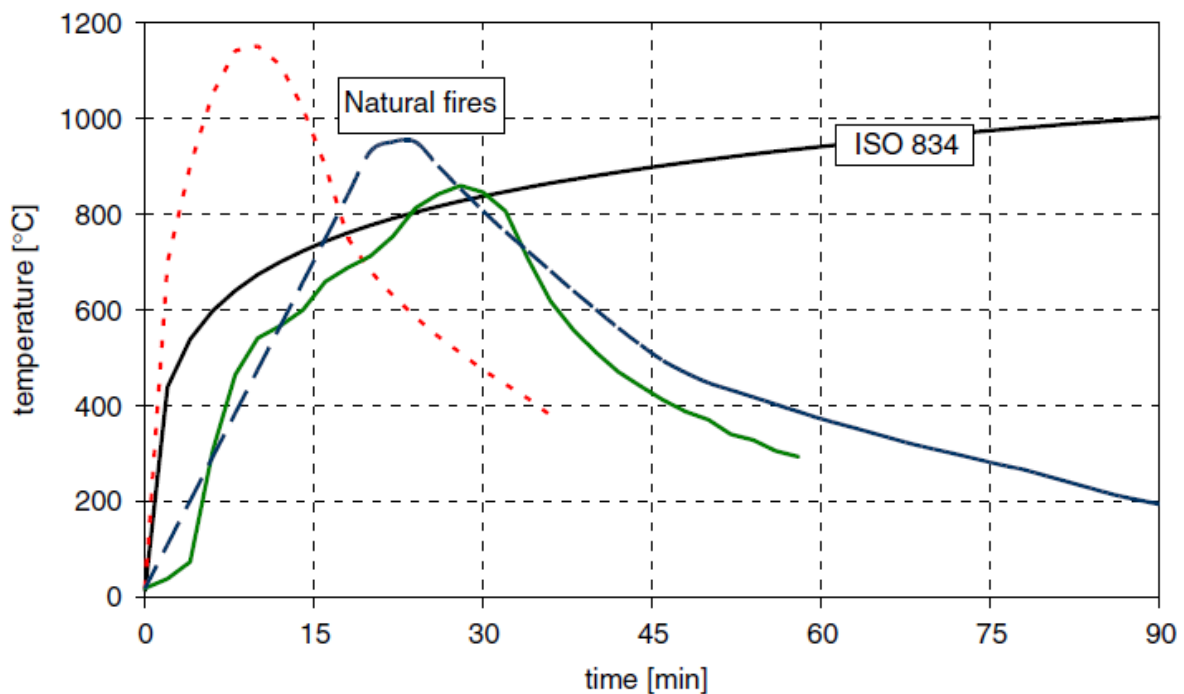


FIG 1.1. A comparison between natural fire curves and the ISO 834 curve [19]

The purpose of this paper is to describe the difference between the temperature calculated using the ISO curve and the temperature occurring in a natural office fire. The rise of the temperature of the steel HEB 300-section column was calculated over a period of 30 minutes. It is enough time to achieve high temperature which may be critical for the unprotected steel column.

2. MATERIALS AND METHODS

2.1. The temperature of the steel column in the standard fire

The temperature of the steel column in a fire situation may be calculated using the iterative method [3]. The standard temperature-time curve is specified in EN 1991-1-2 [1] as:

$$\Theta_g = 20 + 345 \log_{10}(8t + 1) \quad (2.1)$$

where

Θ_g – the temperature of the gas in the fire compartment [°C]

t – the time [min]

The curve is used to represent a fully developed fire. It is an analytical function of temperature over time [2]. The equation describes the heating conditions of the structural element [10]. What is important, the standard ISO 834 temperature-time curve does not represent a real fire [2]. It is used to calculate the temperature of the gas in the fire, which can be used to calculate the temperature of an unprotected steel element exposed to the fire. The input data for calculating the rise of the temperature of the steel column constructed from a HEB 300 section are presented in Table 2.1.

TABLE 2.1. Input data

Parameter	Symbol	Value	Unit
the unit mass of steel	ρ_a	7850	kg/m ³
the correction factor for the shadow effect	k_{sh}	0.62	-
the section factor for the unprotected steel member	A_m/V	116.1	m ⁻¹
the box value of the section factor	$[A_m/V]_b$	80.5	m ⁻¹
the time interval	Δt	4.0	s
the coefficient of heat transfer by convection	α_c	25.0	W/m ² K
the configuration ration factor	Φ	1.0	-
the surface emissivity of the member	ε_m	0.7	-
the emissivity of the fire	ε_f	1.0	-
the Stephan Boltzmann constant	σ	$5.67 \cdot 10^{-8}$	W/m ² K ⁴
the temperature of the gas in the fire in 0 s	$\theta_{g,0}$	20.0	°C
the surface temperature of the steel member in 0 s	$\theta_{m,0}$	20.0	°C
the specific heat of steel in 0 s	$c_{a,0}$	439.8	J/kgK

2.2. The temperature of the steel column in the natural fire

In the present paper, the rise of the temperature of the steel column constructed from a HEB 300 section in the office room was calculated using the Fire Dynamics Simulator. The model of the room was prepared using PyroSim. The office room is presented in Fig. 2.2.

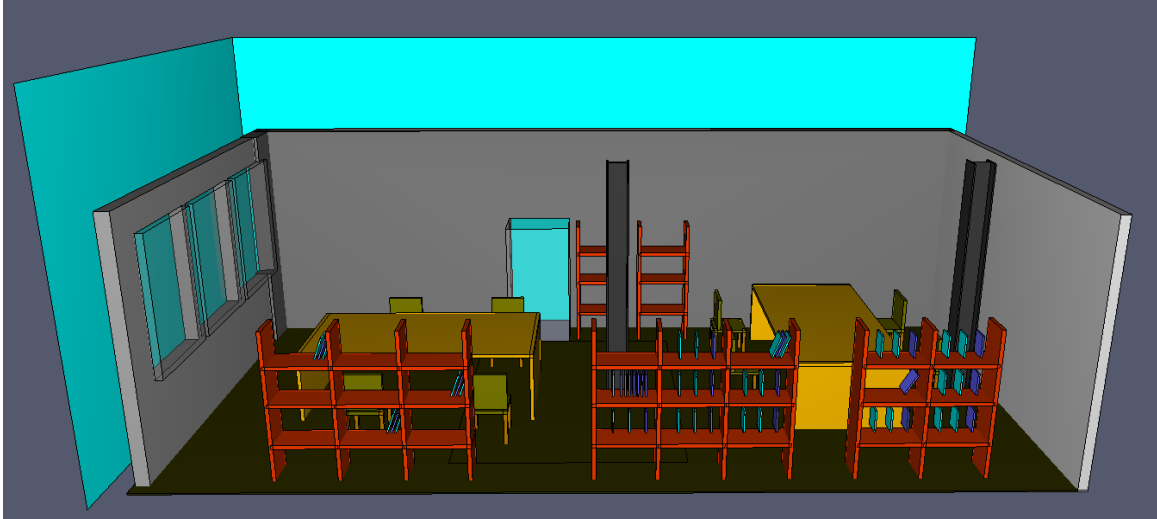


FIG 2.2. The office room prepared in PyroSim

An office room has a medium fire growth rate and a heat release density rate of 250 kW/m^2 . The maximum power released by a fire can be calculated using the following formula [2]:

$$Q = A_{fi} RHR_f \quad (2.2)$$

where

A_{fi} – the maximum reach of the fire [m^2]

RHR_f – the heat release density rate [kW/m^2]

The maximum area that a fire can spread over in an office room without sprinklers is 47m^2 , if it is not fully developed, or the entire area of the room, if it is fully developed [13]. Figure 2.3. presents the evolution of the heat release rate.

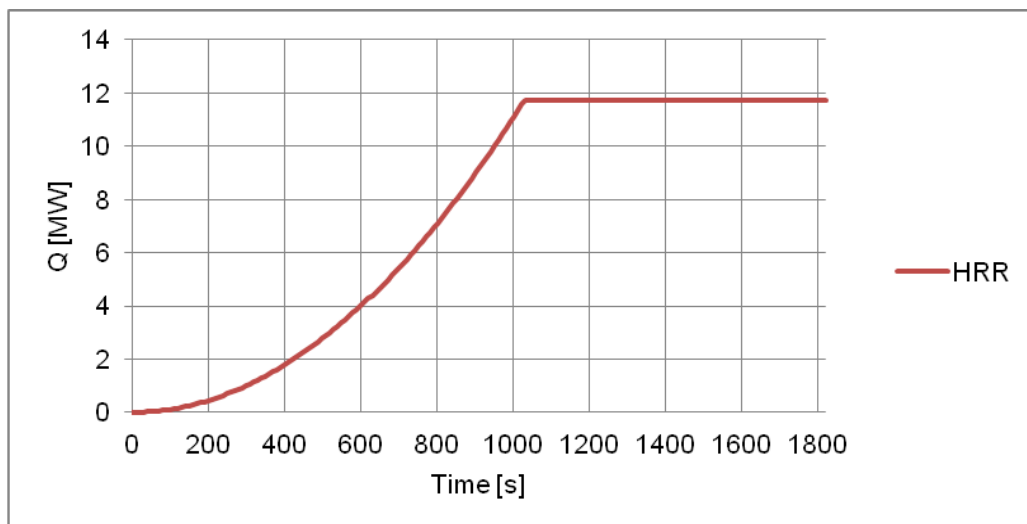


FIG 2.3. The evolution of the RHR

A mesh should be carefully chosen to obtain accurate results [14]. The mesh size depends on the size of the compartment and the power released by the fire. It may be calculated using the FDS Mesh Size Calculator [15]. The model should be verified. Evidence that mathematical models are properly implemented and that the numerical solution is correct with respect to the mathematical model should be delivered [16]. The input data are presented in Table 2.2. Different meshes were used to verify the model.

TABLE 2.2. Input data in the natural fire model

Parameter	Symbol	Value	Unit
the area of the room	A	57.6	m ²
the maximum reach of the fire	A _{fi}	47.0	m ²
the maximum power released by the fire	Q	11.75	MW
the height of the room	h	3.5	m
the width of the room	s	5.16	m
the length of the room	l	11.17	m
the number of doors	-	1	-
the width of the door	-	1.0	m
the height of the door	-	2.0	m
the number of windows	-	3	-
the width of the window	-	1.3	m
the height of the window	-	1.9	m
the surface of walls	-	concrete	-
the surface of the floor	-	felt	-
the surface of desks	-	pine	-
the surface of chairs	-	pine	-
the surface of books	-	paper	-
the surface of bookstands	-	oak	-
the surface of columns	-	steel	-
the time needed to reach 11.75MW	-	1028	s

The most severe fire is a result of the largest possible fuel load [17]. The fire scenario is presented in Table 2.3.

TABLE 2.3. The fire scenario

Time	Action
0 s	ignition, the door and two windows are open
when the detector of smoke is activated	the door is closed
when the detector of temperature is activated	the third window is open
1028 s	the power released by the fire reaches its maximum value

The model was verified using different meshes and cells sizes. The meshes are presented in Table 2.4.

TABLE 2.4. The meshes

Variant	Number of meshes	Size of cells
1	6	0.1 m \times 0.1 m \times 0.1 m for five meshes 0.05 m \times 0.05 m \times 0.05 m for one mesh
2	6	0.25 m \times 0.25 m \times 0.25 m
3	2	0.1 m \times 0.1 m \times 0.1 m
4	2	0.25 m \times 0.25 m \times 0.25 m

Figure 2.4. shows the model with the first and the second mesh variant.

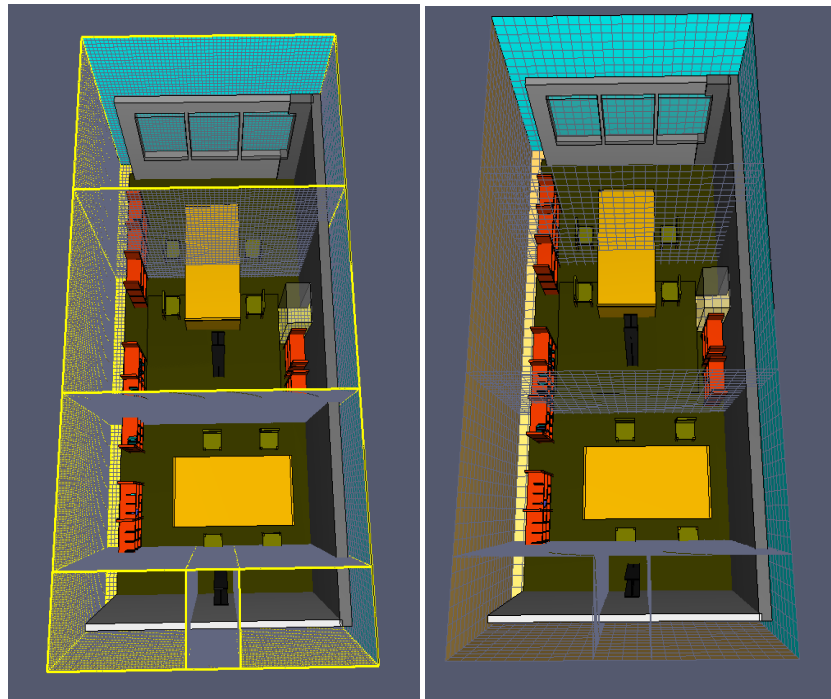


FIG 2.4. The first and the second mesh variant

Figure 2.5. shows the model with the third and the fourth mesh variant.

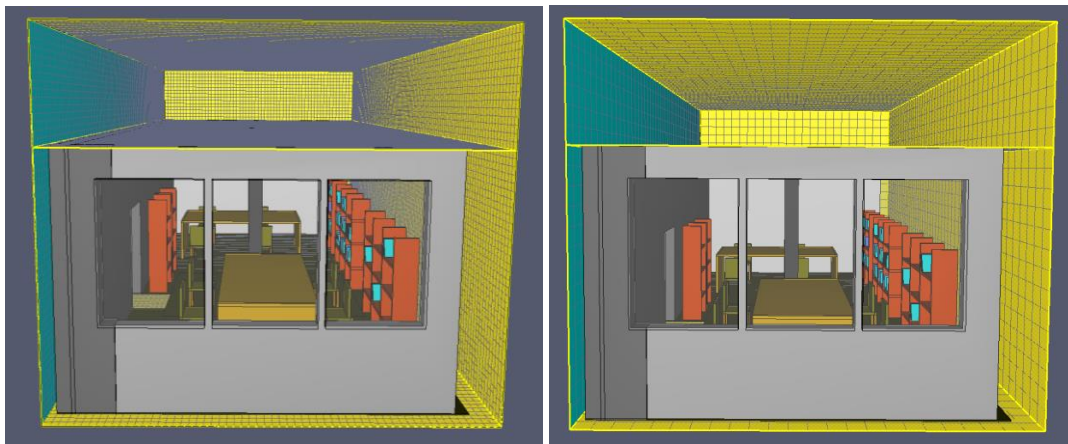


FIG 2.5. The third and the fourth mesh variant

In the first variant, the cell size of the mesh is different from the cell size in other meshes. A smaller cell size was intentionally used near the column. There are two steel columns in the model. The first one is located near the wall, whereas the second one is in the center of the room. The burner surface covers the part of the floor where the second column is located. There are a lot of detectors in the model. The smoke detector is located in the center of the room, 2.2 m above the floor. The device is activated when the obscuration threshold reaches 3.28%/m. Near the window there is a temperature detector which is activated when the gas reaches the temperature of 300°C. The columns are equipped with wall temperature detectors. They are located at a 0.1 m distance from one another.

3. RESULTS

3.1. The temperature of the steel column in the standard fire

The increase in the temperature of the unprotected steel column was calculated over 30 minutes of fire. The final seconds are presented in Table 3.1.

TABLE 3.1. The final seconds of the 30-minute analysis

Time	Θ_g	$h_{\text{net},r}$	$h_{\text{net},c}$	$h_{\text{net},d}$	$c_{a,i}$	$\Delta\theta_{a,t}$	$\theta_{a,t}$
[s]	[°C]	[W/m ²]	[W/m ²]	[W/m ²]	[J/kgK]	[°C]	[°C]
1780	840.13	20047.78	2641.88	22689.66	4332.34	0.20	734.45
1784	840.46	20089.95	2645.45	22735.40	4542.315	0.19	734.65
1788	840.80	20133.40	2649.21	22782.61	4766.762	0.18	734.83
1792	841.13	20178.07	2653.16	22831.24	4994.80	0.18	735.00
1796	841.46	20223.88	2657.29	22881.17	4815.99	0.17	735.17
1800	841.80	20268.50	2661.23	22929.73	4644.76	0.17	735.35

The temperature of the unprotected steel column reached 735.35°C after 30 minutes.

3.2. The temperature of the steel column in the natural fire

The temperature of the gas near the windows was lower than in the center of the room. There was fresh air near windows. The comparison between the temperatures of the gas near the windows in all variants is presented in Figure 3.1.

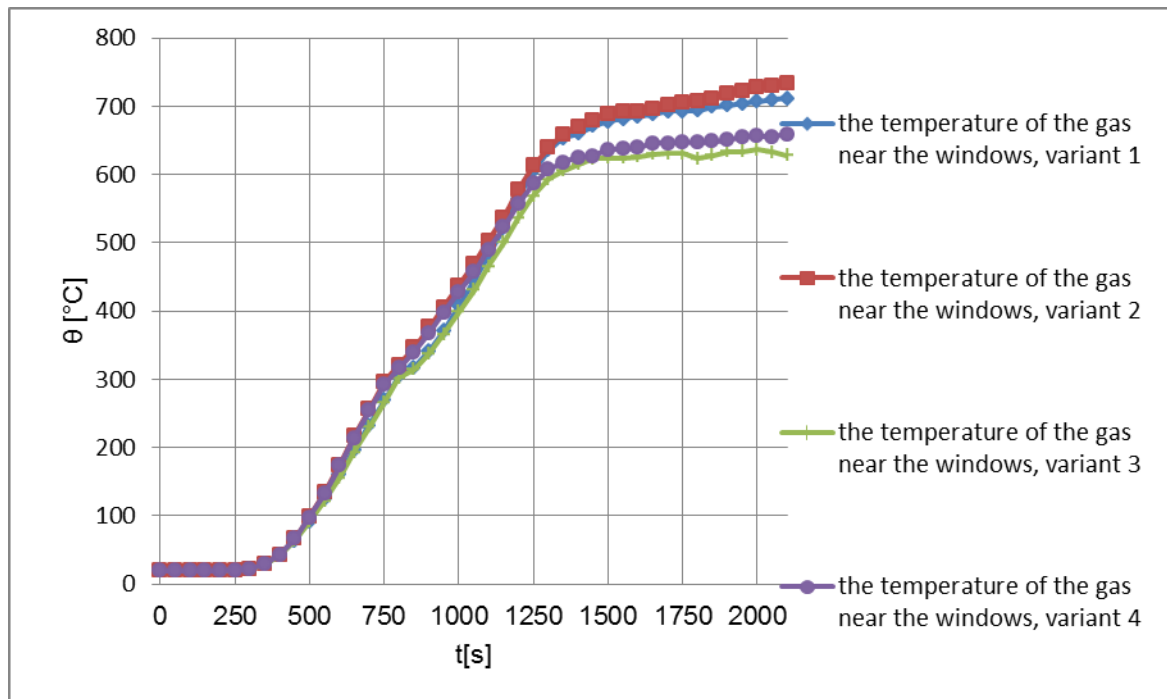


FIG 3.1. The temperatures of the gas near the windows in all variants

The comparison between the temperatures of the gas in the center of the room in all variants is presented in Figure 3.2.

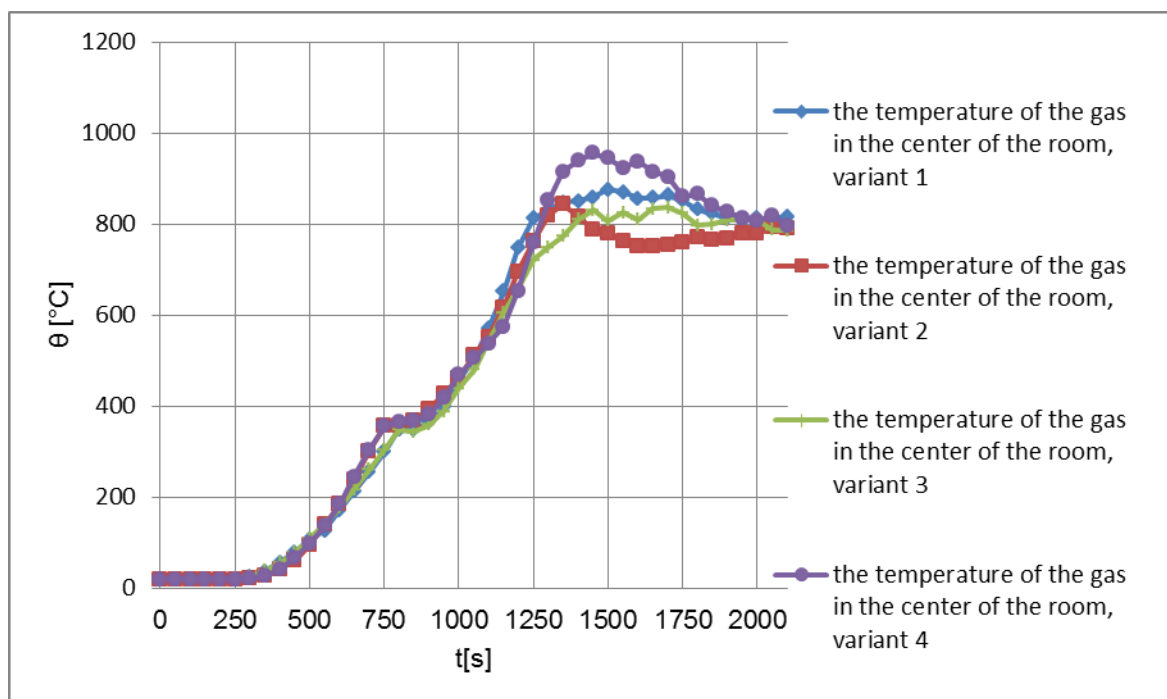


FIG 3.2. The temperatures of the gas in the center of the room in all variants

The column 1 had the maximum temperature at 2.9 m above the ground when the column 2 had at 1.0 m. The column 1 had the maximum temperature at 2.9 m, because there were the hottest gases. The column 2 had the maximum temperature at low height, because it

was specially located on the burner surface. The comparison between the temperatures of column 1 at 1.0 m above the ground in all variants are presented in Figure 3.3.

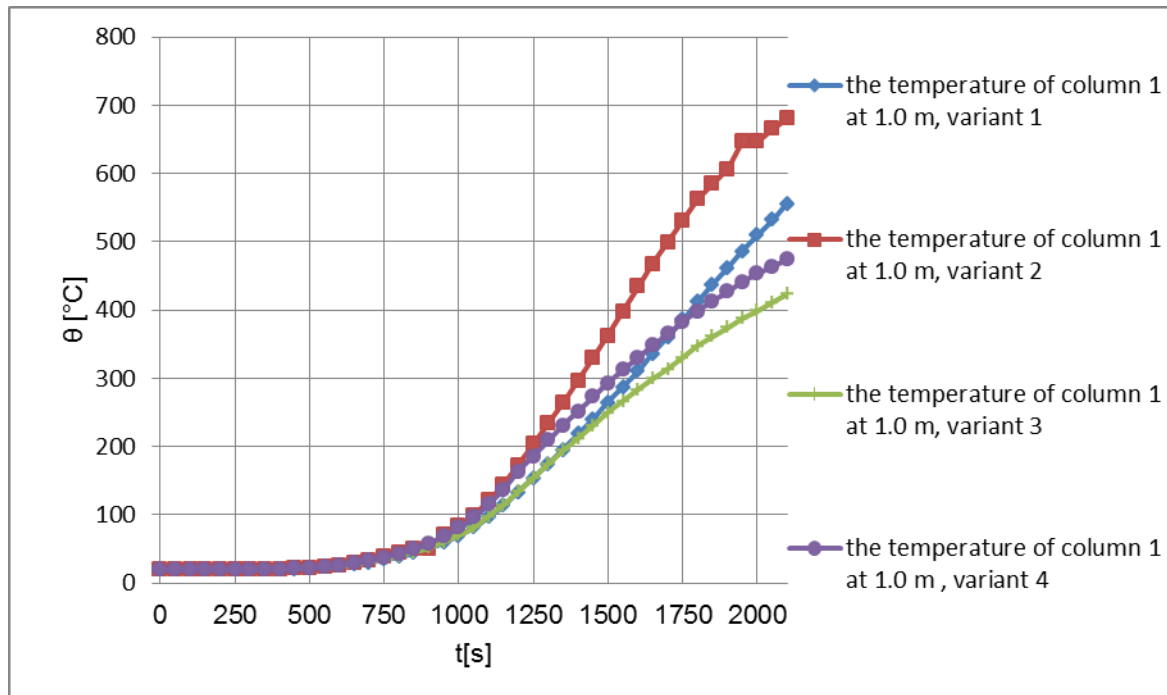


FIG 3.3. The temperatures of column 1 at 1.0 m above the ground

The comparison between the temperatures of column 1 at 2.9 m above the ground in all variants is presented in Figure 3.4.

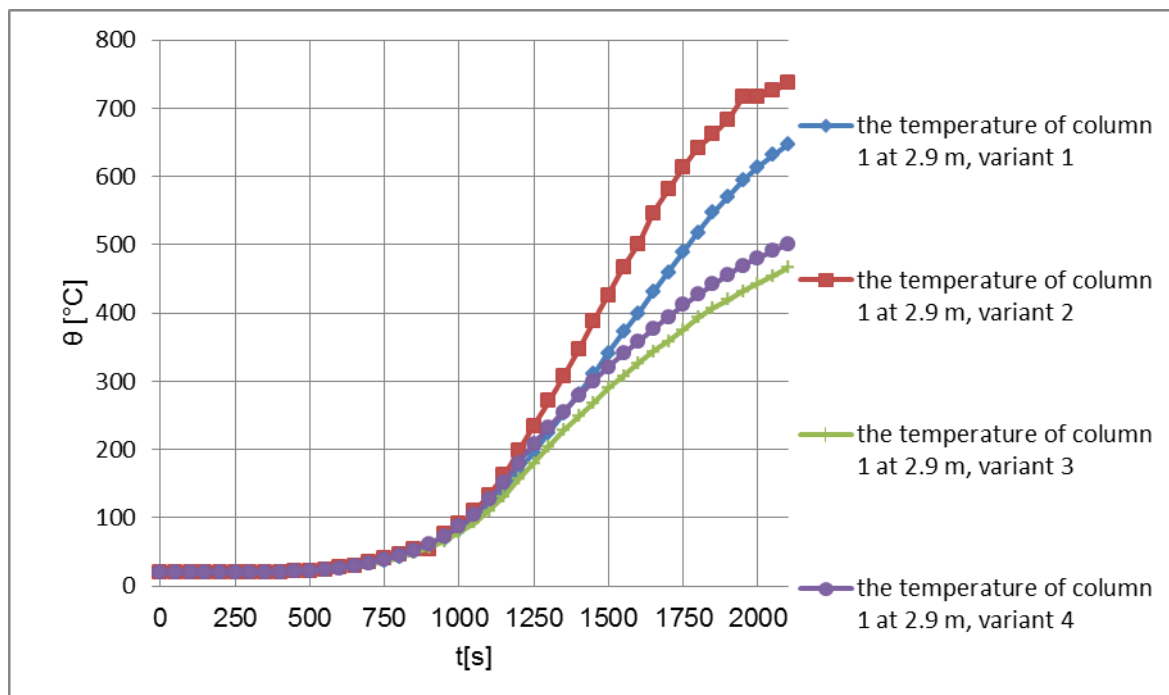


FIG 3.4. The temperatures of column 1 at 2.9 m above the ground in all variants

The comparison between the temperatures of column 2 at 1.0 m above the ground in all variants is presented in Figure 3.5.

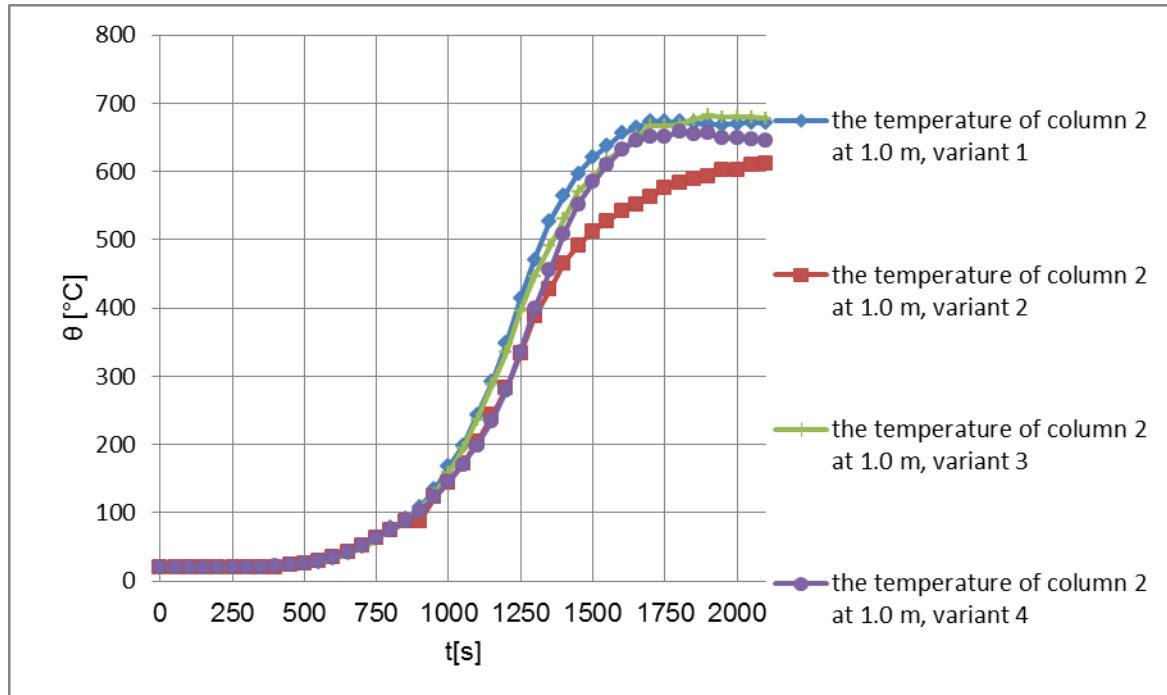


FIG 3.5. The temperatures of column 2 at 1,0 m above the ground in all variants

The comparison between the temperatures of column 2 at 2.9 m above the ground in all variants is presented in Figure 3.6.

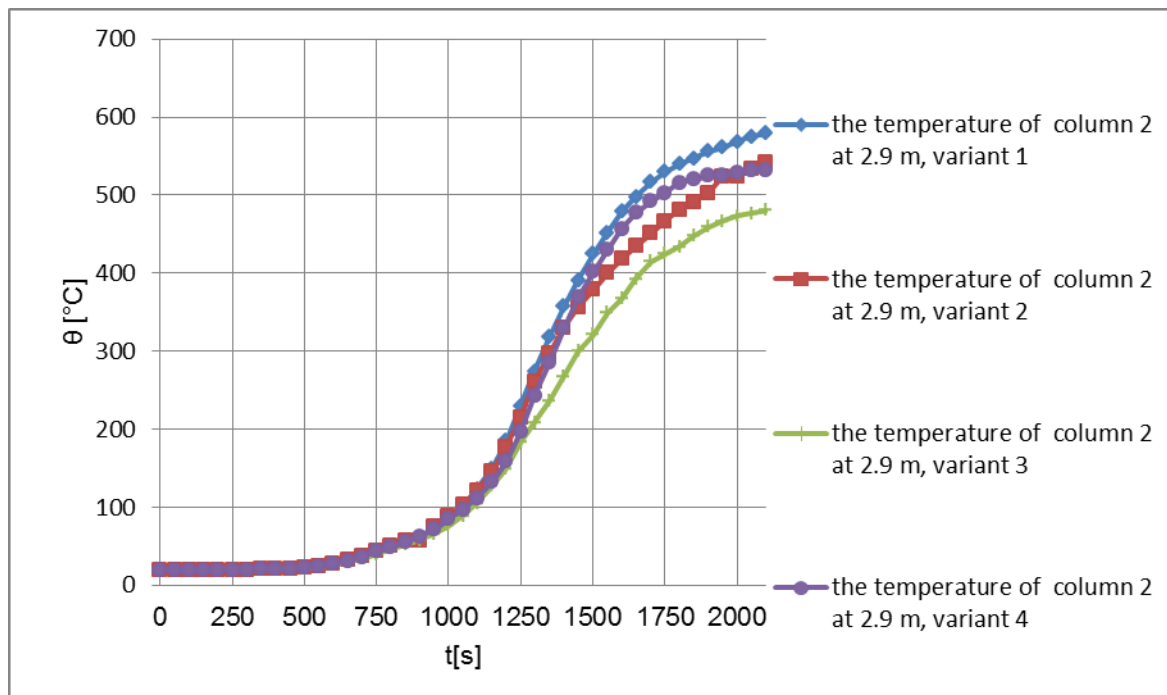


FIG 3.6. The temperatures of column 2 at 2.9 above the ground in all variants

Figure 3.7. shows the evolution of the rate of heat release obtained in the Fire Dynamics Simulator.

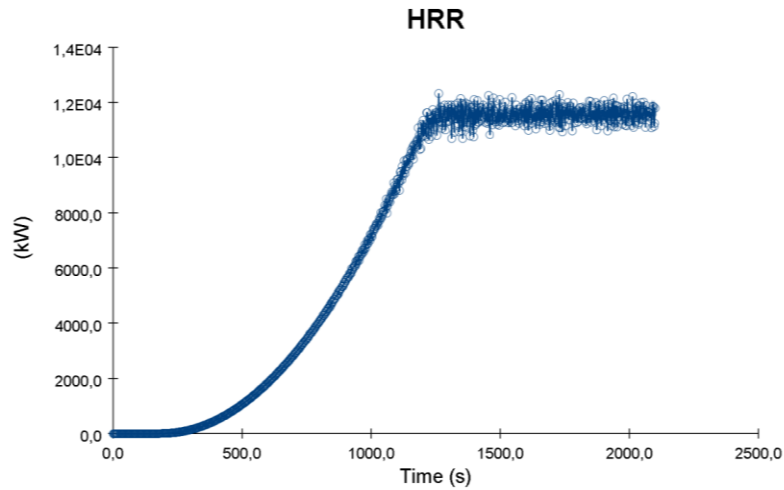


FIG 3.7. The evolution of the rate of heat release obtained in the Fire Dynamics Simulator

Figure 3.7. shows that the fire did not have enough air after reaching the maximum rate of heat release. The RHR line is unstable. It may be one of the reasons for the differences between the results in 1028 s obtained in all variants. The other reason is the accuracy of the meshes.

4. DISCUSSION

A comparison between the rise of the temperature of the unprotected steel column subjected to the standard fire curve ISO 834 and to the natural office fire model is presented in Figure 4.1.

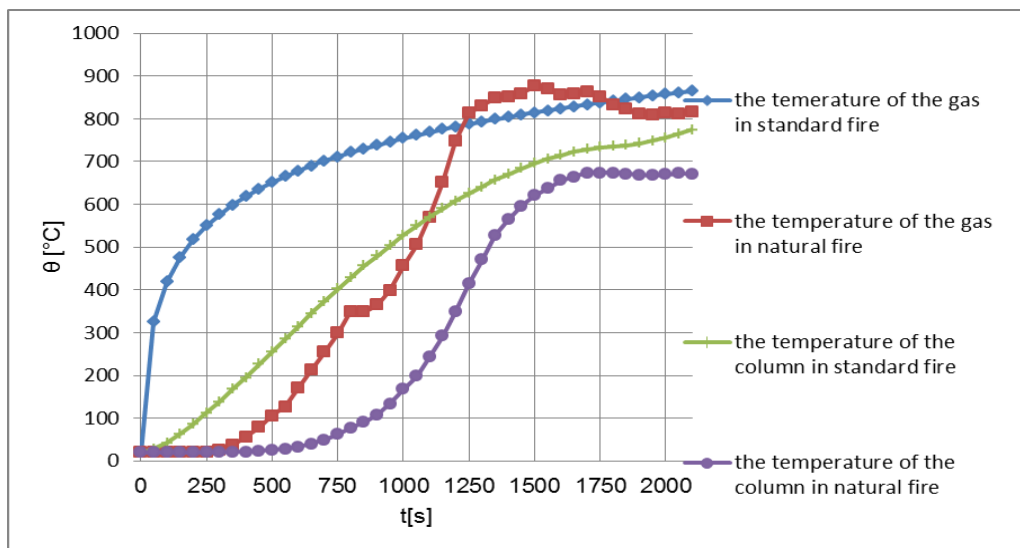


FIG 4.1. The rise of the temperature of the unprotected steel column subjected to the standard fire curve ISO 834 and to the natural office fire model

The temperature of the column in the standard fire was higher than in the natural fire. The result obtained based on the time-temperature relationships is significantly different from the result based on the natural fire model in the first 1500 seconds. From 1500 s to 2000 s, the temperature of the column in the ISO fire is similar to the temperature of the column in the natural fire. The rise of temperature in the standard fire curve ISO 834 is faster than in the natural fire model, which is similar to the results presented in [2] and in Figure 1.1. The temperature of the gases in the natural fire model does not exceed the temperature of the gases in the ISO fire, which is different from the results presented in Figure 1.1. It is because of the small size of the room and the small maximum power released by the fire.

5. CONCLUSIONS

The temperature of the column in the standard fire was higher than in the natural office fire. The standard temperature-time curve does not take into account the parameters of the model. The use of natural fire models in the design process may reduce the costs of fire protection materials, especially in small rooms where the rate of heat release density is low. In simulations of natural fires the size of the mesh has a significant impact on the results. It is more visible in situations where the fire has not enough oxygen, which was the case in this paper.

ACKNOWLEDGMENT

Financial support by the DS grant 11-305/2014 is kindly acknowledged. The authors wish to thank Stigo and Thunderhead Engineering for the PyroSim program.

REFERENCES

1. *Eurocode 1, EN 1991-1-2, Actions on Structures Part 1-2 General Actions – Actions on structures exposed to fire*, European Committee for Standardization, 2002.
2. Frannsen J. M., Real P. V., *Fire Design of Steel Structures*, ECCS Eurocode Design Manuals, 2010.
3. Rzeszut K., Polus Ł., *Classes of Cross-Sections of Steel Structural Elements in the Fire Situation*, Procedia Engineering 57, 967-976, 2013.
4. McGrattan K. et alli, *FDS Dynamics Simulator (Version 5), Technical Reference Guide*, National Institute of Standards and Technology, U.S. Department of Commerce, 2007.
5. Forney G., *User's Guide for Smokeview Version 5 - A Tool for Visualizing Fire Dynamics Simulation Data*, National Institute of Standards and Technology, U.S. Department of Commerce, 2007.
6. *PyroSim User Manual*, Thunderhead Engineering, 2010.
7. Zehfuss J., Hosser D., *A parametric natural fire model for the structural fire design of multi-storey buildings*, Fire Safety Journal 42, 115-126, 2007.
8. Ranby A., *Structural Fire Design of Thin Walled Steel Sections*, Journal of Construction Steel Research 46(1), 303-304, 1998.

9. Smardz P., *Good practice rules for CFD fire modelling using fire dynamics simulator*, 6th International Conference Fire Safety of Construction Works, November 2008, Warsaw, Poland, 2008.
10. Skowroński W., *Fire Safety of Metal Structures, Theory and Design Criteria*, Polish Scientific Publishers, 2004.
11. *Eurocode 3, EN 1993-1-2, Design of steel structures, Part 1-2 General Rules – Structural fire design*, European Committee for Standardization, 2005.
12. Barnett C.R., *Replacing international temperature–time curves with BFD curve*, Fire Safety Journal 42 (2007) 321–327, 2006.
13. Wydawnictwo Edukacyjne, 2012. (in Polish)
14. *BS 7346-4, Components for smoke and heat control systems, Functional recommendations and calculation methods for smoke and heat exhaust ventilation systems, employing steady-state design fires, Code of practice*, BSI, 2003.
15. Nocula W., *Mesh –correct selection and modeling*, Newsletter 11, Stigo (in Polish)
16. *FDS Mesh Size Calculator*, <http://www.koverholt.com/fds-mesh-size-calc/>
17. Kwaśniewski L., *Verification and Validation*, Seminar Advanced Design Methods and Fire Safety, October 2012, Poznan, Poland, 2012.
18. Fleischmann Ch., *Performance based fire protection designing in New Zealand*, Seminar for experts, March 2009, Zakopane, Poland, 2009.
19. J. Zehfussa, D. Hosserb, *A parametric natural fire model for the structural fire design of multi-storey buildings*, Fire Safety Journal 42 (2007) 115–126, 2007.
20. Yong Du, Guo-qiang Li, *A new temperature – time curve for fire – resistance analysis of structures*, Fire Safety Journal 54 (2012) 113–120, 2006.
21. Malendowski M., *Calculation of temperature fields in cross-sections of tubular concrete filled columns in case of fire*, Durability of buildings and constructions, Dolnośląskie Wydawnictwo Edukacyjne, 2012. (in Polish)